



National Fire
And
Civil Emergency
Preparedness
Council



Joint Community Project by Town Councils,
Singapore Civil Defence Force & National Fire
and Civil Emergency Preparedness Council

Guidelines On The Use Of Common Areas In HDB Estates



Ambulance crew and wheel chair bounded person requires at least 1.2m clear width for access.



Clear width of 1.2m with placement of small shoe rack.



Obstruction to emergency crew access due to constricted corridor.



Clear staircase and landing at all times.




Excessive storage of combustibles.



No storage of items within dry/wet riser compartment.



Obstruction to means of escape (staircase).

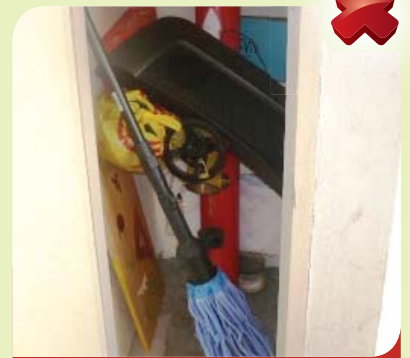

Storage of items within hosereel compartment.